



OG-300 Solar Water Heating System Certification

No./30003791

Issued: April 03, 2013

Expiration Date: March 01, 2026

www.solar-rating.org | (800) 423-6587 | (562) 699-0543

CERTIFICATION HOLDER:

Solahart Industries
101 Bell Road
Montgomery, AL 36117 USA
www.solahart.com.au

EVALUATION SUBJECT

BRAND: Solahart
MODEL: ASE 302J & ASE 302J Free Heat
TYPE: Thermosiphon, Indirect

PRODUCT CERTIFICATION SYSTEM:

The ICC-SRCC OG-300 system certification program includes evaluation and performance ratings for solar water heating systems as established in the *ICC-SRCC Rules for Solar Heating & Cooling Product Listing Reports*. The program also includes periodic factory inspections and surveillance of the manufacturer's quality management system.

COMPLIANCE WITH THE FOLLOWING STANDARD(S):

ICC 900/SRCC 300 - 2020, Solar Thermal System Standard
ENERGY STAR Residential Water Heater Specification (v.5.0)


SOLAR UNIFORM ENERGY FACTOR (SUEF):

9.0, Low Draw Pattern

The Solar Uniform Energy Factor (SUEF) is determined through computer modeling per the specification established in *ICC 900/SRCC 300, Appendix B*.

INSTALLATION:

The solar water heating system must be installed in accordance with the manufacturer's published installation instructions. Installation must conform to the requirements of the applicable code and is subject to approval by the code official having jurisdiction. This certification is valid only for a system composed of the components configured as shown in the schematic below:

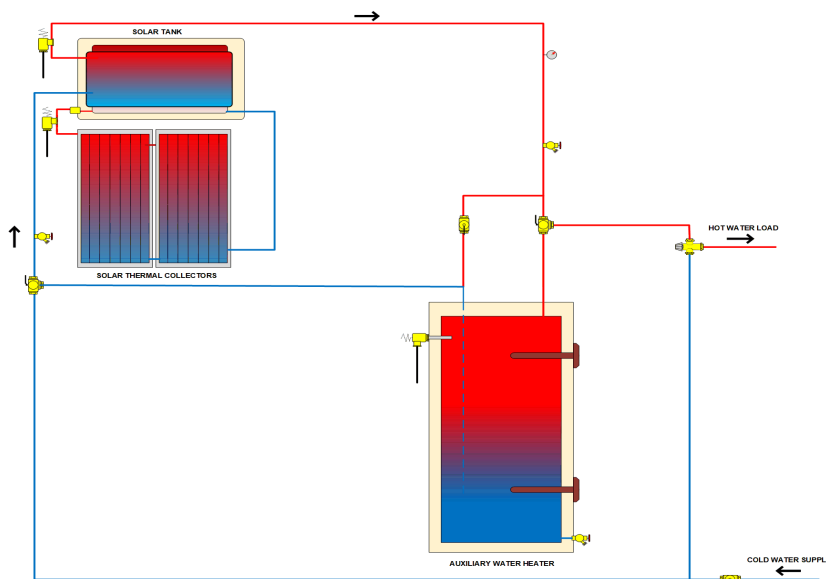

COMPONENT IDENTIFICATION	
	Thermostatic Mixing Valve
	P/T Relief Valve
	Pressure Gauge
	Drain Valve
	3-way valve
	Isolation Valve
	Electric Heating Element

PARTS LIST:

Part	Quantity	Evaluated Component
Collector Option 1	2	Solahart Industries Model J (OG-100 2012020A)
Solar Tank	1	Solahart Industries Model 300J & 300F (300 L volume)
Auxiliary Tank	1	Generic Model Generic (189 L volume)

IDENTIFICATION:

Certified systems must be identified with the OG-300 certification mark below in accordance with the *Rules for Certification Mark and Certificate Use* and labeled in with the information below per *ICC 900/SRCC 300*:



1. Manufacturer's name and model number.
2. OG-300 system certification number
3. OG-100 collector certification number(s) and quantity.
4. Heat transfer fluid and concentration range.
5. Storage and expansion tank volumes.
6. Relief valve specification and setpoint.
7. Maximum water supply pressure.
8. Maximum solar loop pressure.
9. Flow rate range (where a flow meter is installed).
10. Backup energy rating. For electrical, phase/volts/amps. For gas, minimum pressure.
11. Installation date field (to be entered by the installer in the field).

CONDITIONS:

The certified solar water heating system must comply with the following conditions:

1. Systems must be installed and operated in accordance with the manufacturer's instructions and local code.
2. Systems must include all components installed in the configuration shown in the schematic in the OG-300 certification document.
3. Systems must use one of the OG-100 certified solar collector options from the list above. Where more than one collector is installed in a system, all collectors must be the same model.
4. Systems must utilize heat transfer fluids approved by the manufacturer.
5. Certifications are not to be construed as representing aesthetics or any other attributes not specifically addressed, nor are they to be construed as an endorsement of the subject of the report or a recommendation for its use.
6. There is no warranty by ICC-SRCC express or implied, as to any finding or other matter in this certification, or as to any product covered by the certification.
7. This document must be reproduced in its entirety.

REGIONAL RATINGS:

Thermal performance ratings are provided for the system based on computer modeling to standard OG-300 rating conditions and a hot water load of 64.3 gallons per day (243.4 litres per day) at a setpoint of 125°F (51.7°C) for comparison. Performance is given using the following values:

- Annual Solar Fraction (SF_A): The portion of the total conventional hot water heating load (including tank standby losses) provided by solar energy averaged over one year.
- Annual Energy Savings (AES): The projected energy savings over a period of one year for the system compared to a baseline tank-type water heater using the same fuel source.

Results are given for several climate zones throughout North America. Climate zones are as established in *ANSI/ASHRAE 169, Climatic Data for Building Design Standard*. Actual thermal performance and energy savings for an installed system will vary with local conditions, installation details and hot water usage.

UNITED STATES OF AMERICA

OG-300 LOCAL ANNUAL SOLAR WATER HEATING SYSTEM PERFORMANCE

System performance at several geographic locations in the United States corresponding to climate zones as established in ASHRAE 169 is provided below. Ratings are determined using weather data, solar irradiance and water supply temperature over a period of one year for the specific locations listed below. Ratings for locations in California and Hawaii are provided on separate state maps on the following pages.



USA			
Location	Climate Zone (ASHRAE 169)	Solar Fraction (SF _A)	Annual Energy Savings (kWh)
AK - Anchorage	7	0.23	1220
AZ - Phoenix	2B	0.78	2760
CO - Denver	5B	0.51	2360
FL - Tampa	2A	0.62	2140
GA - Atlanta	3A	0.49	2000
MA - Boston	5A	0.38	1760
MO - St Louis	4A	0.44	1900
MT - Helena	6B	0.38	1880
TX - Dallas-Fort Worth	3A	0.57	2180
WA - Seattle	4C	0.33	1510
WI - Milwaukee	6A	0.35	1700

STATE OF CALIFORNIA

OG-300 LOCAL ANNUAL SOLAR WATER HEATING SYSTEM PERFORMANCE

System performance at several geographic locations in the state of California corresponding to building climate zones as established by the California Energy Commission (CEC) is provided below. Ratings are determined using weather data, solar irradiance and water supply temperature over a period of one year for the specific locations listed below.



State of California			
Location **	Climate Zone (ASHRAE 169)*	Solar Fraction (SF _A)	Annual Energy Savings (kWh)
CCZ 1 - Arcata	7	0.37	1680
CCZ 2 - Santa Rosa	6B	0.53	2300
CCZ 3 - Oakland	3C	0.52	2240
CCZ 4 - Sunnyvale	4C	0.56	2370
CCZ 5 - Santa Maria	5C	0.57	2470
CCZ 6 - Los Angeles	3B	0.57	2250
CCZ 7 - San Diego	3B	0.58	2280
CCZ 8 - El Toro	3B	0.61	2440
CCZ 9 - Burbank	3B	0.62	2530
CCZ 10 - Riverside	3B	0.65	2550
CCZ 11 - Red Bluff	3B	0.58	2310
CCZ 12 - Sacramento	3B	0.59	2390
CCZ 13 - Fresno	3B	0.64	2540
CCZ 14 - China Lake	3B	0.67	2540
CCZ 15 - El Centro	3B	0.79	2690
CCZ 16 - Mt. Shasta	7	0.48	2190

* Climate zones are as established in ANSI/ASHRAE 169, Climatic Data for Building Design Standard.

** California Building Climate Zones and representative cities are established by the California Energy Commission for use in the CA Title 24 Energy Efficiency Standards

HAWAIIAN ISLANDS

OG-300 LOCAL ANNUAL SOLAR WATER HEATING SYSTEM PERFORMANCE

System performance at several geographic locations in the Hawaiian Islands corresponding to climate zones as established in ASHRAE 169 is provided below. Ratings are determined using weather data, solar irradiance and water supply temperature over a period of one year for the specific locations listed below.



State of Hawaii			
Location	Climate Zone (ASHRAE 169)	Solar Fraction (SF _A)	Annual Energy Savings (kWh)
Hawaii Island - Hilo	1	0.54	1780
Honolulu - Oahu Island	1	0.66	2100
Maui Island - Kahului	1	0.69	2180
Hawaii Island - Keahol	1	0.66	2220
Lihue - Kauai Island	1	0.62	2020
Ho'olehua - Molokai Island	1	0.68	2160

CANADA

OG-300 LOCAL ANNUAL SOLAR WATER HEATING SYSTEM PERFORMANCE

System performance at several geographic locations in Canada corresponding to climate zones as established in ASHRAE 169 is provided below. Ratings are determined using weather data, solar irradiance and water supply temperature over a period of one year for the specific locations listed below. The local annual ratings are provided for a 243 L/day (64.3 gal/day) hot water load.



Canada			
Location	Climate Zone (ASHRAE 169)	Solar Fraction (SF _A)	Annual Energy Savings (kWh)
AB - Edmonton	5	0.35	1880
NS - Halifax	7A	0.30	1470
ON - Thunder Bay	7A	0.37	1800
QC - Quebec City	5	0.34	1740
MB - Winnipeg	7A	0.35	1880
AB - Calgary	7A	0.39	2060
BC - Vancouver	7	0.34	1570

CENTRAL AMERICA AND CARIBBEAN REGION

OG-300 LOCAL ANNUAL SOLAR WATER HEATING SYSTEM PERFORMANCE

System performance at several geographic locations in Central America and the Caribbean region corresponding to climate zones as established in ASHRAE 169 is provided below. Ratings are determined using weather data, solar irradiance and water supply temperature over a period of one year for the specific locations listed below.



Central America & Carribean Region			
Location	Climate Zone (ASHRAE 169)	Solar Fraction (SF _A)	Annual Energy Savings (kWh)
Barbados - Christ Church	1	0.76	2340
Costa Rica - San Jose	1	0.70	3180
Jamaica - Kingston	1	0.85	2610
Mexico - Monterrey	2	0.48	1830
Mexico - Mexico City	2	0.52	2380
Belize - Belize City	1	0.60	1870
Puerto Rico - San Juan	1	0.71	2200